


# ENGINEERING BUILDING

## LEVEL 1 - EMERGENCY EVACUATION & LOCATION PLAN



Assembly Points	Pull Station	Male Washroom	Indicates Access for People with Disabilities	Automated External Defibrillator (AED) Level 4 Across from EN- 4004, Level 2 across from EN-2022A & Level 1 Outside EN-1023
Primary Exit	Fire Extinguisher	Female Washroom		
Secondary Exit	Fire Extinguisher & Hose Connection	Washroom		
Corridors / Stairwells	Stairwell	Elevator		
Rooms / Building				

### KEY PLAN AND ASSEMBLY POINTS

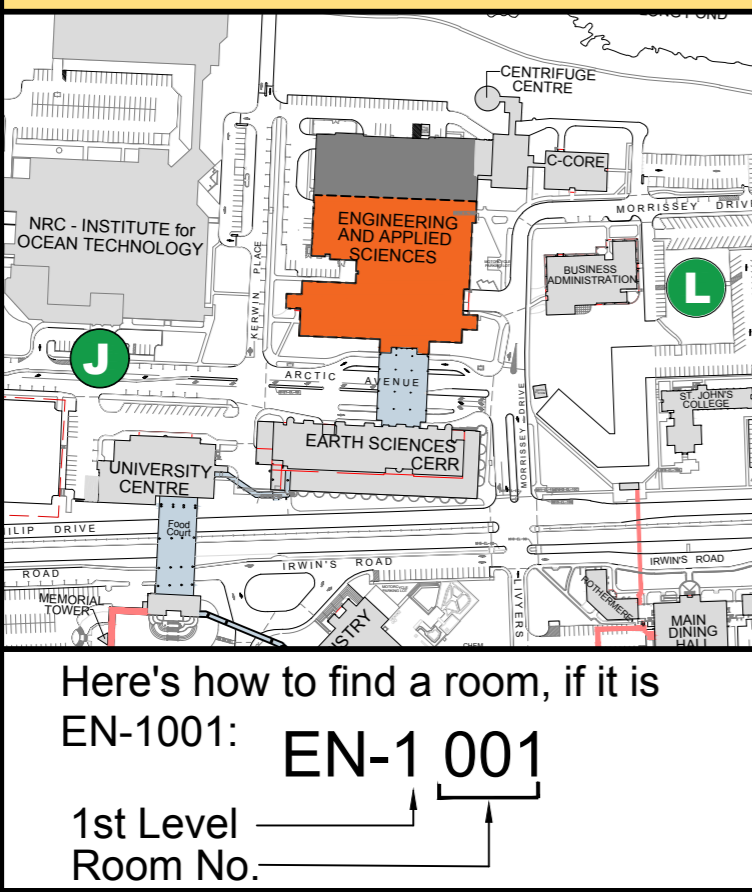

### If The Fire Alarm Sounds:

1. Stop all work and remain calm;
2. Evacuate IMMEDIATELY using the nearest safe exit, proceed outside, and clear the building to a minimum distance of 100 m (300 feet) to the nearest assembly point: DO NOT USE ELEVATORS FOR EVACUATION PURPOSES;
3. If you require assistance to evacuate:
  - a. take shelter in a safe location,
  - b. inform someone of your location, and
  - c. ask them to notify CEP or Fire Department (Main Entrance) of your location.
4. Do not attempt to remove any vehicle from the parking lot/garage;
5. Obey all instructions of the Emergency Wardens and CEP;
6. Comply with Fire Department orders; and
7. Return to the building only when CEP has authorized you to do so.

### If You Discover Fire, See Smoke Or Smell Gas:

1. Sound alarm to warn occupants; (Fire alarm pull station)
2. Evacuate IMMEDIATELY using the nearest safe exit, proceed outside, and clear the building to a minimum distance of 100 m (300 feet) to the nearest assembly point: DO NOT USE ELEVATORS FOR EVACUATION PURPOSES;
3. If you require assistance to evacuate:
  - a. take shelter in a safe location,
  - b. inform someone of your location, and
  - c. ask them to notify CEP or Fire Department (Main Entrance) of your location.
4. If trained to do so, fight fire using a fire extinguisher only if it is small and not between you and an exit; and
5. Call Campus Enforcement and Patrol at 864-4100


# ENGINEERING BUILDING

## LEVEL 2 - EMERGENCY EVACUATION & LOCATION PLAN



Assembly Points	Corridors / Stairwells	Stairwell
Primary Exit	Rooms / Building	Elevator
Secondary Exit	Pull Station	Indicates Access for People with Disabilities
Automated External Defibrillator (AED) Level 4 across from EN-4004, Level 2 across from EN-2022A & Level 1 Outside EN-1023	Fire Extinguisher	Male Washroom
	Fire Extinguisher & Hose Connection	Female Washroom
		Washroom

### KEY PLAN AND ASSEMBLY POINTS

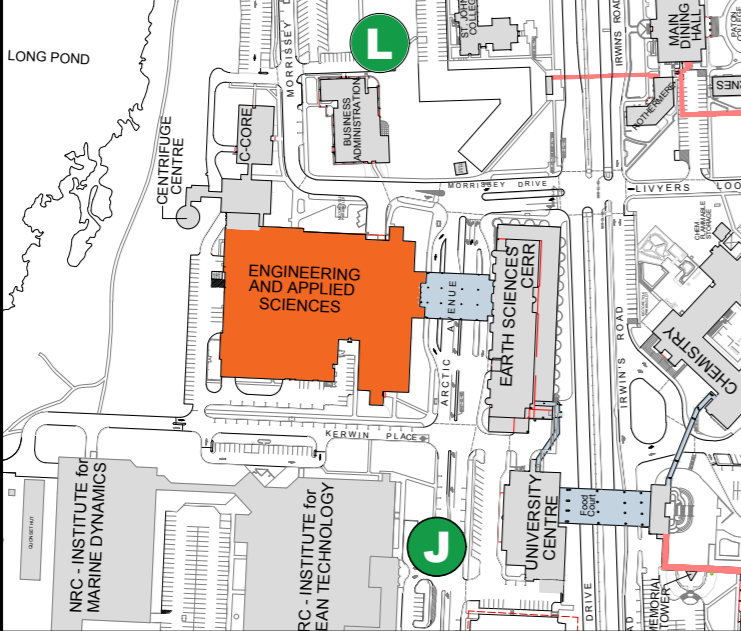

Here's how to find a room, if it is  
EN-2001: **EN-2 001**  
2nd Level  
Room No.

### If The Fire Alarm Sounds:

1. Stop all work and remain calm;
2. Evacuate IMMEDIATELY using the nearest safe exit, proceed outside, and clear the building to a minimum distance of 100 m (300 feet) to the nearest assembly point: DO NOT USE ELEVATORS FOR EVACUATION PURPOSES;
3. If you require assistance to evacuate:
  - a. take shelter in a safe location,
  - b. inform someone of your location, and
  - c. ask them to notify CEP or Fire Department (Main Entrance) of your location.
4. Do not attempt to remove any vehicle from the parking lot/garage;
5. Obey all instructions of the Emergency Wardens and CEP;
6. Comply with Fire Department orders; and
7. Return to the building only when CEP has authorized you to do so.

### If You Discover Fire, See Smoke Or Smell Gas:

1. Sound alarm to warn occupants; (Fire alarm pull station)
2. Evacuate IMMEDIATELY using the nearest safe exit, proceed outside, and clear the building to a minimum distance of 100 m (300 feet) to the nearest assembly point: DO NOT USE ELEVATORS FOR EVACUATION PURPOSES;
3. If you require assistance to evacuate:
  - a. take shelter in a safe location,
  - b. inform someone of your location, and
  - c. ask them to notify CEP or Fire Department (Main Entrance) of your location.
4. If trained to do so, fight fire using a fire extinguisher only if it is small and not between you and an exit; and
5. Call Campus Enforcement and Patrol at 864-4100


# ENGINEERING BUILDING

## LEVEL 3 - EMERGENCY EVACUATION & LOCATION PLAN



Assembly Points	Pull Station	Male Washroom	Indicates Access for People with Disabilities	Automated External Defibrillator (AED) Level 4 Across from EN- 4004, Level 2 across from EN-2022A & Level 1 Outside EN-1023
Primary Exit	Fire Extinguisher	Female Washroom		
Secondary Exit	Fire Extinguisher & Hose Connection	Washroom		
Corridors / Stairwells	Stairwell	Elevator		
Rooms / Building				

### KEY PLAN AND ASSEMBLY POINTS

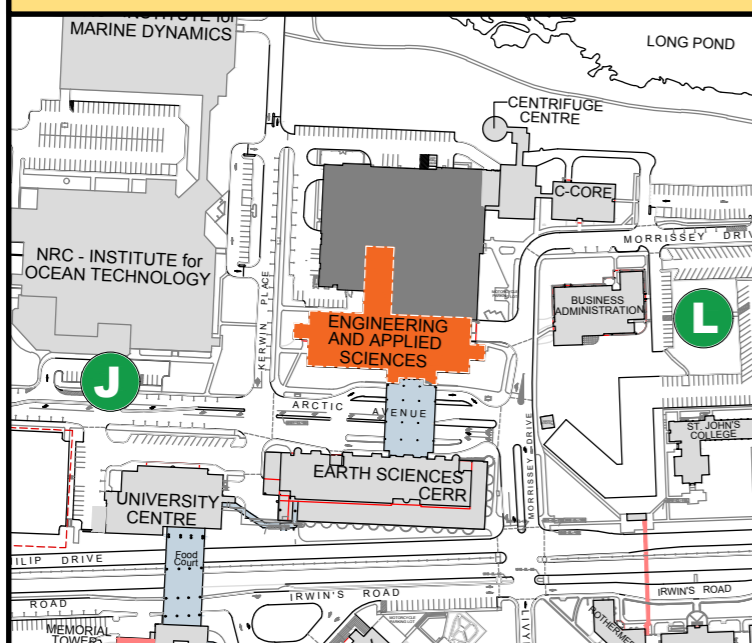

Here's how to find a room, if it is EN-3001: EN-3 001  
3rd Level Room No.

### If The Fire Alarm Sounds:

1. Stop all work and remain calm;
2. Evacuate IMMEDIATELY using the nearest safe exit, proceed outside, and clear the building to a minimum distance of 100 m (300 feet) to the nearest assembly point: DO NOT USE ELEVATORS FOR EVACUATION PURPOSES;
3. If you require assistance to evacuate:
  - a. take shelter in a safe location,
  - b. inform someone of your location, and
  - c. ask them to notify CEP or Fire Department (Main Entrance) of your location.
4. Do not attempt to remove any vehicle from the parking lot/garage;
5. Obey all instructions of the Emergency Wardens and CEP;
6. Comply with Fire Department orders; and
7. Return to the building only when CEP has authorized you to do so.

### If You Discover Fire, See Smoke Or Smell Gas:

1. Sound alarm to warn occupants; (Fire alarm pull station)
2. Evacuate IMMEDIATELY using the nearest safe exit, proceed outside, and clear the building to a minimum distance of 100 m (300 feet) to the nearest assembly point: DO NOT USE ELEVATORS FOR EVACUATION PURPOSES;
3. If you require assistance to evacuate:
  - a. take shelter in a safe location,
  - b. inform someone of your location, and
  - c. ask them to notify CEP or Fire Department (Main Entrance) of your location.
4. If trained to do so, fight fire using a fire extinguisher only if it is small and not between you and an exit; and
5. Call Campus Enforcement and Patrol at 864-4100


# ENGINEERING BUILDING

## LEVEL 4 - EMERGENCY EVACUATION & LOCATION PLAN



Assembly Points	Pull Station	Male Washroom	Indicates Access for People with Disabilities	Automated External Defibrillator (AED) Level 4 Across from EN- 4004, Level 2 across from EN-2022A & Level 1 Outside EN-1023
Primary Exit	Fire Extinguisher	Female Washroom		
Secondary Exit	Fire Extinguisher & Hose Connection	Washroom		
Corridors / Stairwells	Stairwell	Elevator		
Rooms / Building				

### KEY PLAN AND ASSEMBLY POINTS

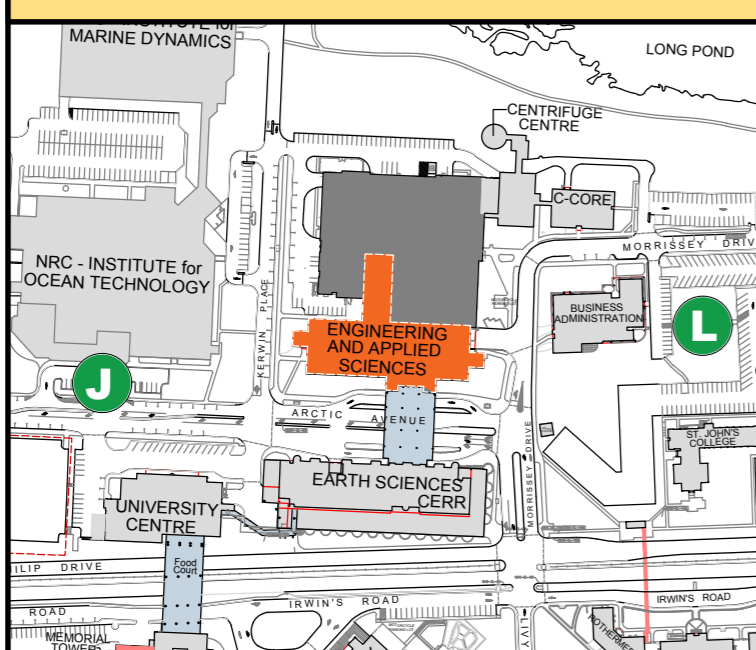

Here's how to find a room, if it is EN-4001:  
 EN-4 001  
 4th Level  
 Room No.

### If The Fire Alarm Sounds:

1. Stop all work and remain calm;
2. Evacuate IMMEDIATELY using the nearest safe exit, proceed outside, and clear the building to a minimum distance of 100 m (300 feet) to the nearest assembly point: DO NOT USE ELEVATORS FOR EVACUATION PURPOSES;
3. If you require assistance to evacuate:
  - a. take shelter in a safe location,
  - b. inform someone of your location, and
  - c. ask them to notify CEP or Fire Department (Main Entrance) of your location.
4. Do not attempt to remove any vehicle from the parking lot/garage;
5. Obey all instructions of the Emergency Wardens and CEP;
6. Comply with Fire Department orders; and
7. Return to the building only when CEP has authorized you to do so.

### If You Discover Fire, See Smoke Or Smell Gas:

1. Sound alarm to warn occupants; (Fire alarm pull station)
2. Evacuate IMMEDIATELY using the nearest safe exit, proceed outside, and clear the building to a minimum distance of 100 m (300 feet) to the nearest assembly point: DO NOT USE ELEVATORS FOR EVACUATION PURPOSES;
3. If you require assistance to evacuate:
  - a. take shelter in a safe location,
  - b. inform someone of your location, and
  - c. ask them to notify CEP or Fire Department (Main Entrance) of your location.
4. If trained to do so, fight fire using a fire extinguisher only if it is small and not between you and an exit; and
5. Call Campus Enforcement and Patrol at 864-4100